1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

An MALION Technical Center

Test Report

RIVERBANK.ALIONSCIENCE.COM

**Sound Absorption** 

**RAL<sup>TM</sup>-A15-277** 

Page 1 of 7

FOUNDED 1918 BY WALLACE CLEMENT SABINE

FOR: Auralex Acoustics Indianapolis, IN.

CONDUCTED: 2015-10-06

ON: LENRD Bass Trap

### TEST METHOD

Riverbank Acoustical Laboratories<sup>™</sup> is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2005 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-09a: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-05(2012): "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measuring procedure and room qualifications is available upon request.

### DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the manufacturer as LENRD Bass Trap. A full internal inspection performed on the test specimen by Riverbank personnel verified the manufacturer's description.

### LENRD Bass Trap (Angled)

Material:	Open cell polyurethane foam
Dimensions	36 at 304.80 mm (12.0 in.) wide by 603.25 mm (23.75 in.) long
Depth:	Varies, 304.80 mm (12.0 in.) maximum
Density:	$25.63 \text{ kg/m}^3 (1.60 \text{ lbs./ft}^3)^*$

### **Physical Measures**

Size:	2.73 m (107.50 in.) wide by 2.41 m (95.00 in.) long
Thickness:	304.80 mm (12.00 in.)
	28.69 kg (63.25 lbs.)
Mass per Unit Area:	$4.35 \text{ kg/m}^2 (0.89 \text{ lbs./ft}^2)$
Area:	$6.59 \text{ m}^2 (70.90 \text{ ft}^2)$

### **Test Environment**

Volume:	$292.0 \text{ m}^3 (10,311.0 \text{ ft}^3)$
Temperature:	20.7±0.1°C (69.3±0.1°F)
Humidity:	59.0±1.8%
Barometric Pressure:	99.5 kPa.

\* = Information provided by manufacturer and not verified by RAL.



RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

NVLAP LAB CODE 100227-0 THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

An MALION Technical Center

Test Report

RIVERBANK.ALIONSCIENCE.COM

**RALTM-A15-277** 

Page 2 of 7

FOUNDED 1918 BY WALLACE CLEMENT SABINE

Auralex Acoustics 2015-10-06



Figure 1 - Specimen mounted in the test chamber.



Figure 2 - Detail of the test specimen.



RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL. THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

INVLAP LAB CODE 100227-0 THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

An MALION Technical Center

Test Report

RIVERBANK.ALIONSCIENCE.COM

**RAL™-A15-277** 

Page 3 of 7

FOUNDED 1918 BY WALLACE CLEMENT SABINE

Auralex Acoustics

2015-10-06

#### MOUNTING METHOD

Type A Mounting: The test specimen was laid directly against the test surface. The perimeter edges were exposed, as would be typical of an actual installation of this specimen.

#### TEST RESULTS

1/3 Octave Center Frequency	Total Absorption (SI)	Total Absorption (IP)	Absorption Coefficient
(Hz)	$(m^2)$	(Sabins)	(Sabins / $ft^2$ )
100	6.89	74.17	1.05
** 125	8.57	92.22	1.30
160	7.99	85.98	1.21
200	9.67	104.08	1.47
** 250	10.24	110.17	1.55
315	9.67	104.13	1.47
400	9.83	105.81	1.49
** 500	10.06	108.26	1.53
630	10.00	110.10	1.55
050	10.23	110.10	1.55
800	10.02	107.87	1.52
** 1000	9.75	104.95	1.48
1250	9.86	106.13	1.50
1 40.0		107 10	
1600	9.96	107.18	1.51
** 2000	9.72	104.65	1.48
2500	9.77	105.17	1.48
3150	9.73	104.77	1.48
** 4000	9.93	106.92	1.51
5000	10.15	109.29	1.54
	~	. = .	

SAA = 1.50 NRC = 1.50



RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL. THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

NVLAP LAB CODE 100227-0 IHIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

An MALION Technical Center

Test Report

RIVERBANK.ALIONSCIENCE.COM

**RAL™-A15-277** 

Page 4 of 7

FOUNDED 1918 BY WALLACE CLEMENT SABINE

Auralex Acoustics 2015-10-06

TEST RESULTS (Continued)

The sound absorption average (SAA) is defined as a single number rating, the average, rounded to the nearest 0.01, of the sound absorption coefficient of a material for the twelve one-third octave bands from 200 through 2500 Hz, inclusive.

The noise reduction coefficient (NRC) is defined from previous versions of this same test method as the average of the coefficients at 250, 500, 1000, and 2000 Hz, expressed to the nearest integral multiple of 0.05.

Tested by Marc Sciaky *Experimentalist* 

Report by Chris Nottoli

Chris Nottoli Acoustician

Approved b Eric P. Wolfram Laboratory Manager



RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL. THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

INVLAP LAB CODE 100227-0 THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

An MALION Technical Center

Test Report

RIVERBANK.ALIONSCIENCE.COM

RAL<sup>TM</sup>-A15-277


Page 5 of 7

FOUNDED 1918 BY WALLACE CLEMENT SABINE

Auralex Acoustics 2015-10-06

### SOUND ABSORPTION REPORT

LENRD Bass Trap

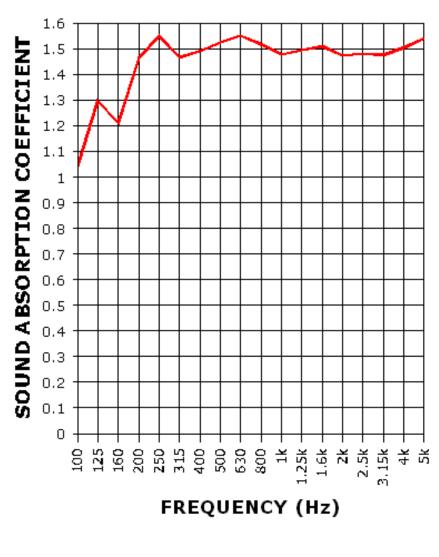

SAA = 1.50 NRC = 1.50



RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

NVLAP LAB CODE 100227-0 THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

An @ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

WALLACE CLEMENT SABINE

FOUNDED 1918 BY

Test Report

RAL<sup>TM</sup>-A15-277

Page 6 of 7

Auralex Acoustics 2015-10-06

#### **APPENDIX A: Extended Frequency Range Data**

Specimen: LENRD Bass Trap (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-09a, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band Center Frequency (Hz)	<b>Total Absorption</b> (Sabins)	<b>Absorption</b> <b>Coefficient</b> (Sabins / ft <sup>2</sup> )
31.5	14.29	0.20
40	14.04	0.20
50	4.70	0.07
63	39.80	0.56
80	34.96	0.49
100	74.17	1.05
125	92.22	1.30
160	85.98	1.21
200	104.08	1.47
250	110.17	1.55
315	104.13	1.47
400	105.81	1.49
500	108.26	1.53
630	110.10	1.55
800	107.87	1.52
1000	104.95	1.48
1250	106.13	1.50
1600	107.18	1.51
2000	104.65	1.48
2500	105.17	1.48
3150	104.77	1.48
4000	106.92	1.51
5000	109.29	1.54
6300	112.27	1.58
8000	121.76	1.72
10000	130.67	1.84
12500	142.04	2.00



RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

NVLAP LAB CODE 100227-0 THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

An MALION Technical Center

Test Report

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY WALLACE CLEMENT SABINE

**Auralex Acoustics** 

2015-10-06

<u>RAL<sup>TM</sup>-A15-277</u>

Page 7 of 7

### **APPENDIX B: Instruments of Traceability**

Specimen: LENRD Bass Trap (See Full Report)

	Serial	Date of	Calibration
<b>Model</b>	<u>Number</u>	<b>Certification</b>	Due
Туре 3560-С	2647140	2015-04-08	2016-04-08
Type 4943-B-001	2311427	2015-07-27	2016-07-27
Type42AF-1	80001	2015-08-14	2016-08-14
SD700	Q790841	2015-09-16	2016-09-16
	Туре 3560-С Туре 4943-В-001 Туре42АF-1	ModelNumberType 3560-C2647140Type 4943-B-0012311427Type42AF-180001	ModelNumberCertificationType 3560-C26471402015-04-08Type 4943-B-00123114272015-07-27Type42AF-1800012015-08-14

END



RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL. THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.